


LUNOS e² Quick Guide - **Switch** Operation Manual

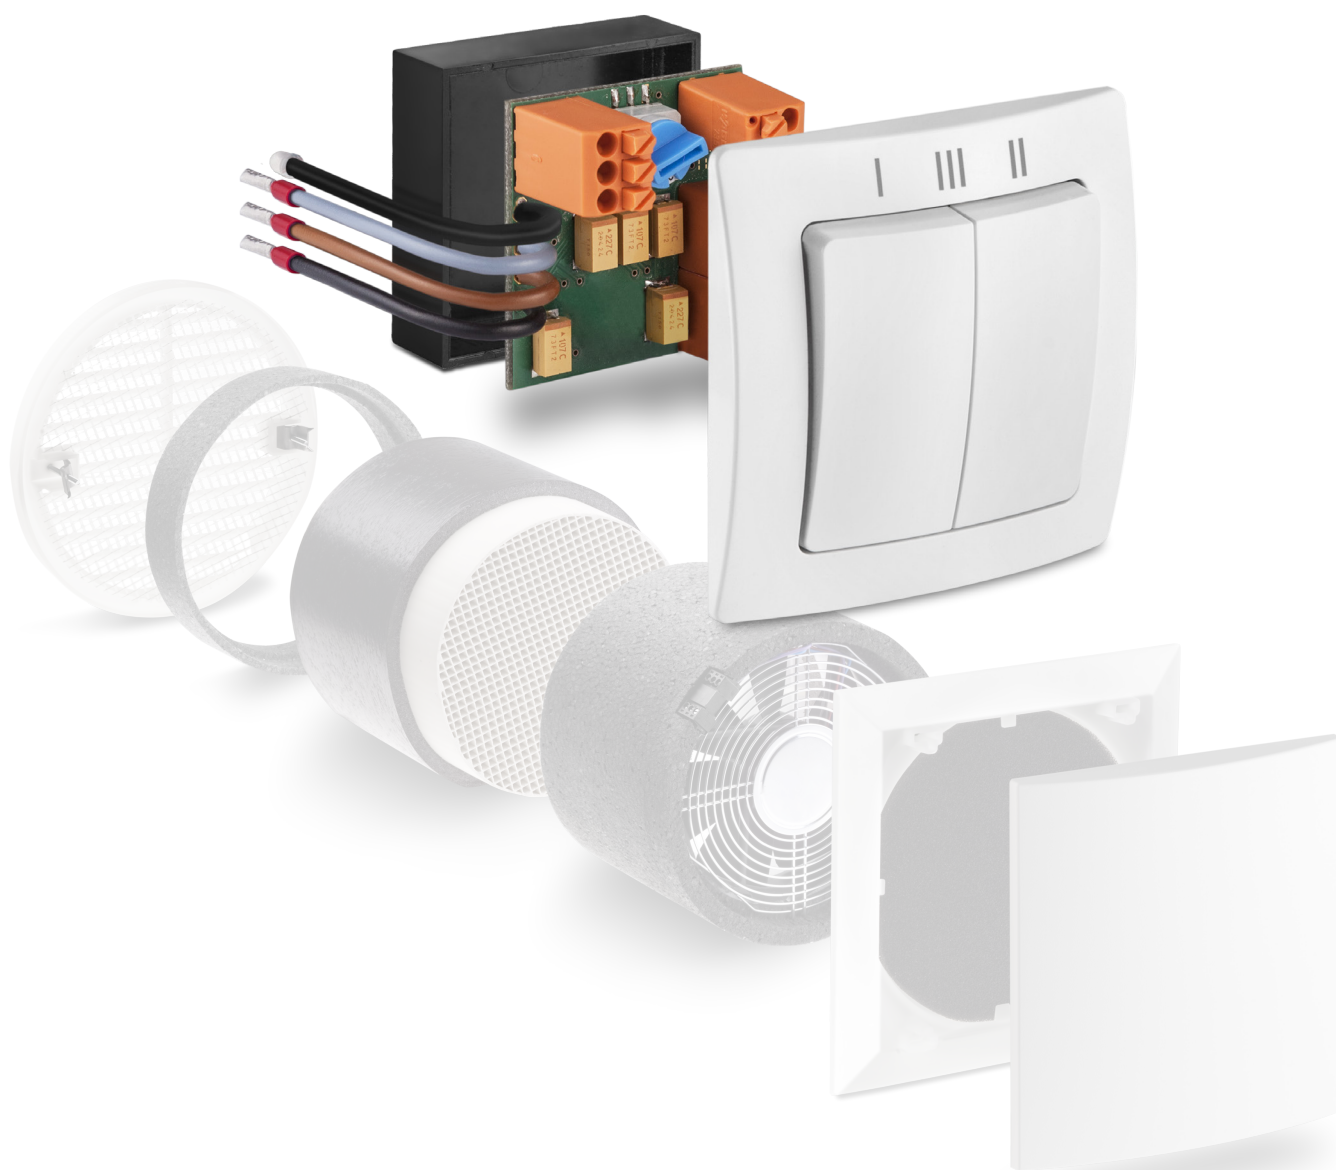


LEVEL 1 VENTILATION

Unit operates in energy recovery mode.

15m³/hr

For use when external conditions are very uncomfortable (i.e. very cold winter night, very hot summer day). Units operate very quietly with maximum energy recovery efficiency and supply fresh air at a low rate. Suitable for times of low activity when family is sleeping or no-one is home.

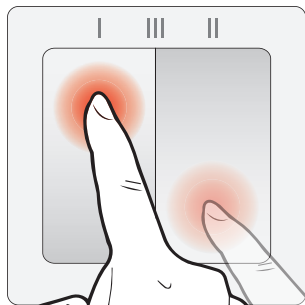


LEVEL 2 VENTILATION

Unit operates in energy recovery mode.

30m³/hr

For use when external conditions are not comfortable (i.e. cold winter day and night, hot summer day). Units operate quietly with high energy recovery efficiency and supply fresh air at a steady rate. Suitable for times of medium household activity when people are active while at home.

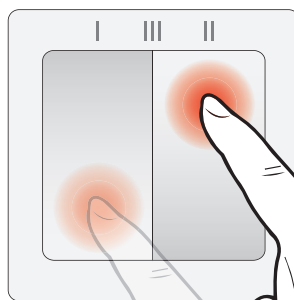


LEVEL 3 VENTILATION

Unit operates in energy recovery mode.


38m³/hr

For use when larger amounts of fresh air are required (i.e. while many people are active within the house or while excess moisture is building up from showers). Units operate with slightly lowered energy recovery efficiency and supply fresh air at a high rate.

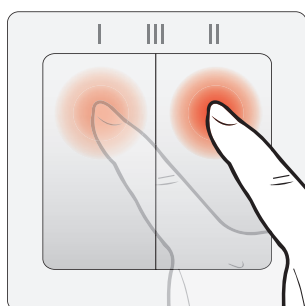

Switching OFF the unit.

For use when house will not be occupied for an extended period of time. Units do not operate.

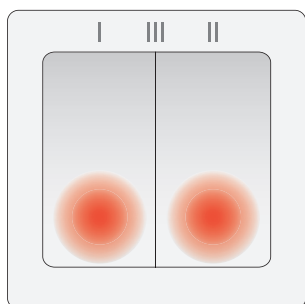

SUMMER BYPASS MODE

This is activated from any level by switching the right hand side switch **OFF** and **ON** within 2 seconds. The LED will emit a short flash - repeat procedure to turn off bypass mode, the LED will emit a long flash.

Unit operates in **VENTILATION** mode & **DOES NOT** operate in energy recovery mode.

15 - 38m³/hr

For use when external conditions are more comfortable than internal conditions (i.e. cool summer night after a very hot day, pleasant spring/autumn day). Units operate without energy recovery and supply fresh air at a high rate.

